
	Record Reference	R.O.W./ Permits	Y	N	Job Planned By	Estimate
	U.G.	<input type="checkbox"/>			Engr.	Keep Cost
	Aer.	<input checked="" type="checkbox"/>			Tel. No.	8ABV30
	Block					
Reason For Work		QLL. Involved			Draftsman's Initials	Print No. C-1
<b>FTTP - DOBBS FERRY</b> <b>152 BROADWAY, DOBBS FERRY</b> <b>H3003</b>		Outage Req'd			Planner's Int.	C.O. DOBBS FERRY
		Sta.Prot.Req'd			Sub-Dist	Division WCHR
RULE 53 Tel. Underground Plant Involved <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/> Does Not Apply <input type="checkbox"/> Does Apply As Follows		Plt.Ret.Over \$10,000			Date	Block No. ---
		QLL Cable No.			Date	Tax Dist.
		Primary Voltage To Ground	13.2KV		Date	
		Pressure Network Diagram			Revision	MWR No.
		Tel. Compl. Date			Date	EL. Grid
		EL. Service Req'd Date			Date	Municipality T/O DOBBS FERRY
		EL. Jt. No.			Date	Issue Date
					Date	Job Class FAMXJ

**MATERIAL LIST**

QTY	DESCRIPTION	O.D.	FM
558'	5845C PL PL 2" PD		
75'	5845C PL PL 1" PVC		
3	5845C PL PL LG PENCELL		
4	5845C PL PL SM PENCELL		
1	5845C PL FLOWER POT		

\* = EL METER

**NOTE: REFER TO PLATT DOBBS FERRY FILE NO. 18 BLOCK 526 FOR POSSIBLE USE OF EXISTING CONDUIT**

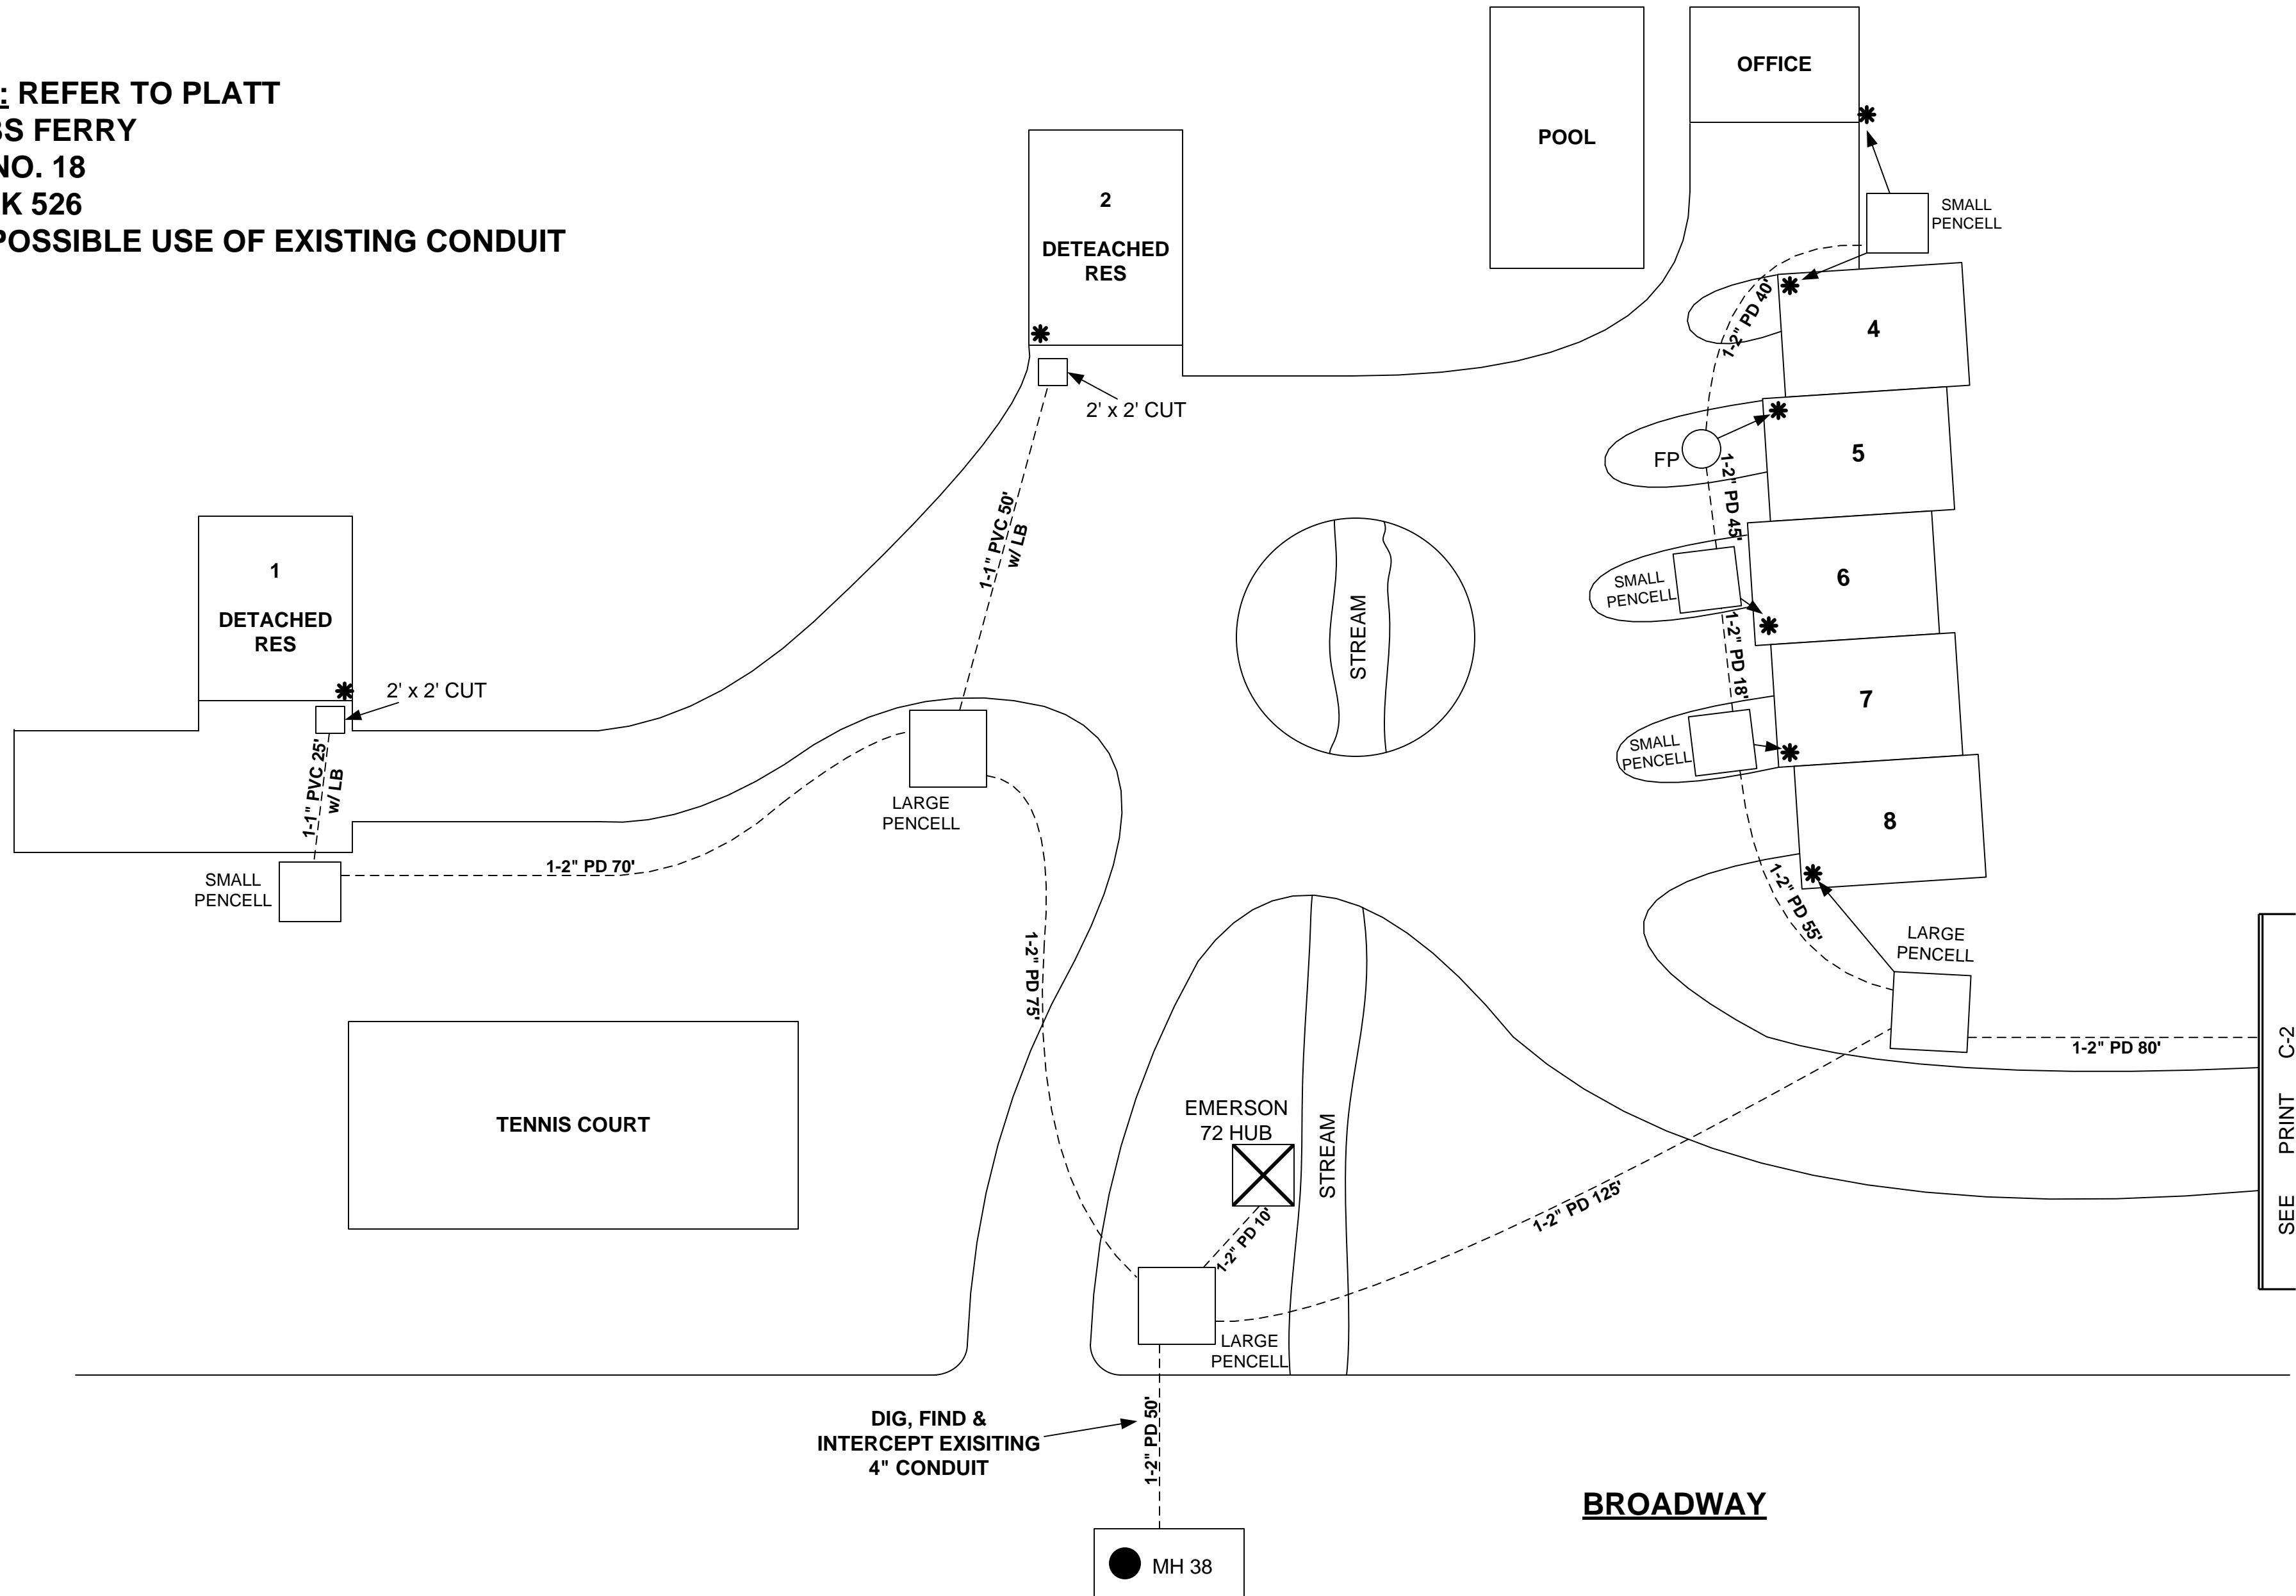


SEE PRINT C-2

Record Reference		R.O.W./ Permits		Job Planned By		Estimate	
U.G. _____		<input type="checkbox"/>		Engr. _____		Keep Cost 8ABV30	
Aer. _____		<input checked="" type="checkbox"/>		Tel. No. _____		C.W. Order	
Block _____		QLL Involved		Draftsman's Initials		Rou. Order	
Conduit _____		Outage Req'd		Planner's Int.		Print No. C-2	
Reason For Work		Sta.Prot.Req'd		Sub-Dist		C.O. DOBBS FERRY	
FFTP - DOBBS FERRY 152 BROADWAY, DOBBS FERRY H3003		Pit.Ret.Over \$10,000		Date		Division WCHR	
		QLL Cable No.		Date		Block No. ---	
RULE 53		Est. Cost		Primary Voltage To Ground 13.2KV		Division	
Tel. Underground Plant Involved <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		C \$		Pressure Network Diagram		Revision	
<input checked="" type="checkbox"/> Does Not Apply		X \$		Tel. Compl. Date		Date	
<input type="checkbox"/> Does Apply As Follows		Gross \$		EL. Service Req'd Date		App'd	
		M & R \$		EL. Jt. No.		MWR No.	
		Pit. Ret. \$				EL. Grid	
						Municipality T/O DOBBS FERRY	
						Issue Date	
						Job Class FAMXJ	


**MATERIAL LIST**

QTY	DESCRIPTION	O.D.	FM
497'	5845C PL PL 2" PD		
4	5845C PL PL LG PENCELL		
4	5845C PL PL SM PENCELL		
4	5845C PL FLOWER POT		

\* = EL METER

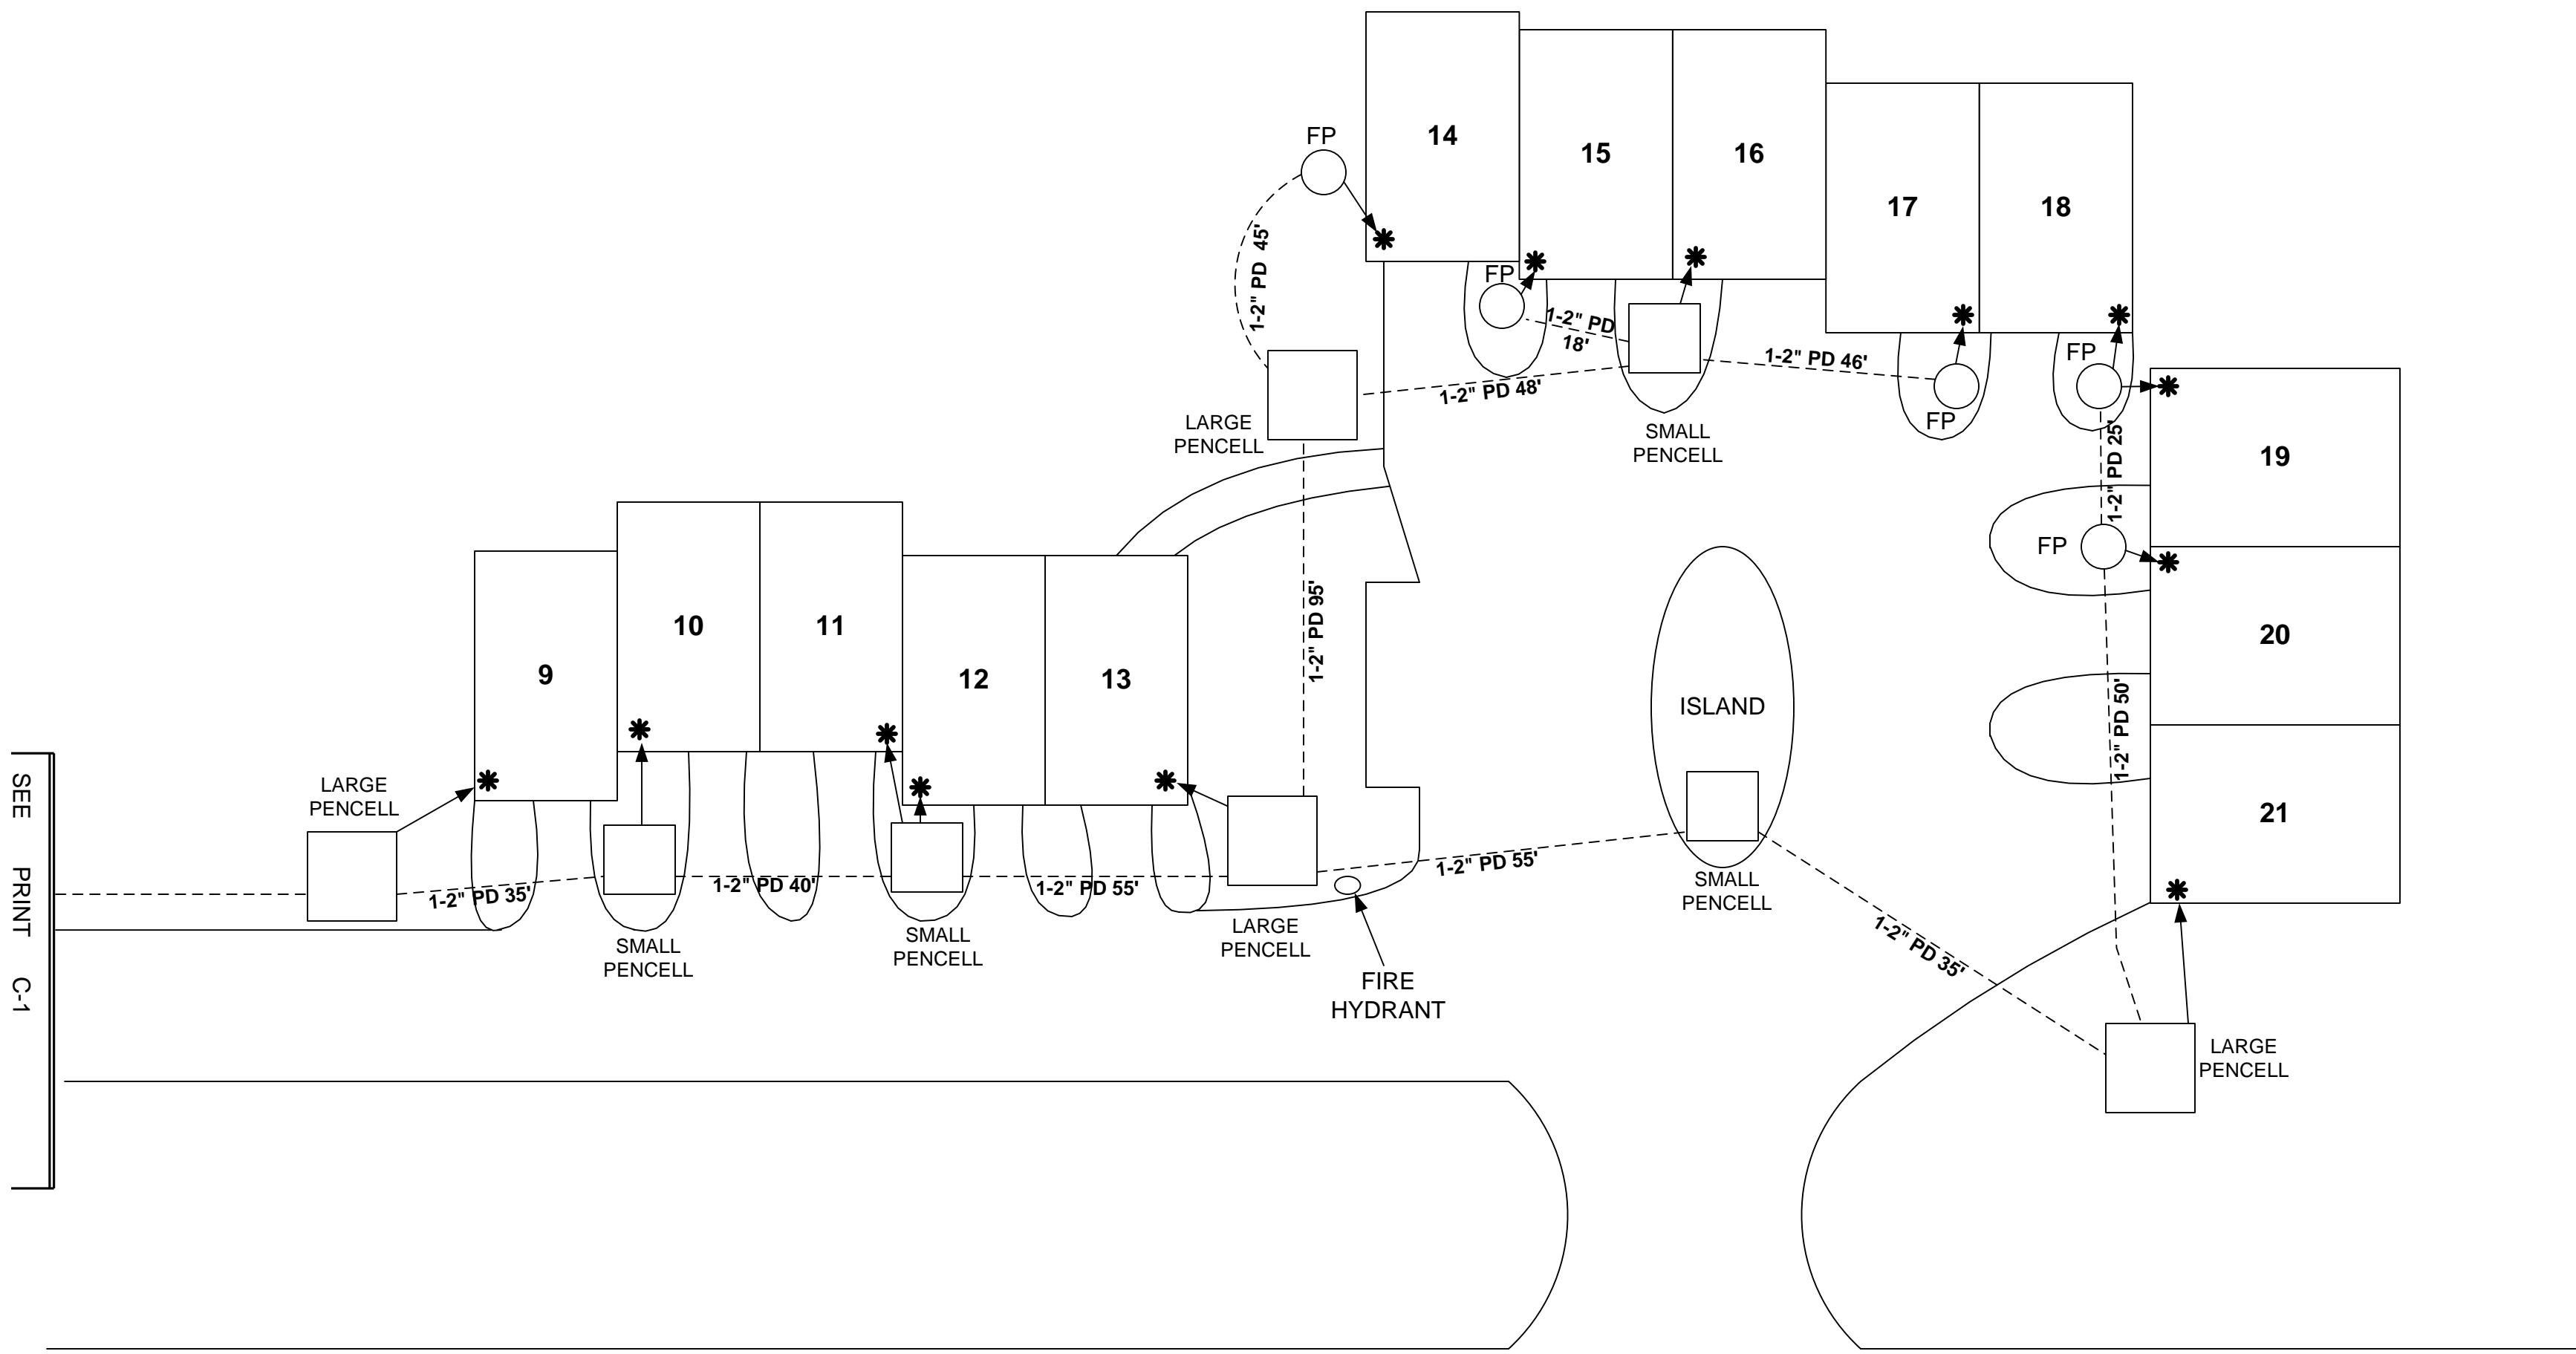

**BROADWAY**


	Record Reference		R.O.W./ Permits	Y	N	Job Planned By	Engr. _____	Estimate Keep Cost C.W. Order Rou. Order	8ABV30											
	U.G.		<input type="checkbox"/>	E	O															
	Aer.		<input type="checkbox"/>	S		QLL. Involved	<input checked="" type="checkbox"/>	Tel. No. _____	Print No. C-1											
	Block		<input type="checkbox"/>			Outage Req'd	<input checked="" type="checkbox"/>	Draftsman's Initials	C.O. DOBBS FERRY											
Reason For Work		FTTP - DOBBS FERRY 152 BROADWAY, DOBBS FERRY H3003		Sta.Prot.Req'd	<input checked="" type="checkbox"/>	Planner's Int.	Date	Division	WCHR											
RULE 53 Tel. Underground Plant Involved <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/> Does Not Apply <input type="checkbox"/> Does Apply As Follows		Est. Cost <table border="1"> <tr><td>C</td><td>\$</td></tr> <tr><td>X</td><td>\$</td></tr> <tr><td>Gross</td><td>\$</td></tr> <tr><td>M &amp; R</td><td>\$</td></tr> <tr><td>Plt. Ret.</td><td>\$</td></tr> </table>		C	\$	X	\$	Gross	\$	M & R	\$	Plt. Ret.	\$	Primary Voltage To Ground	13.2KV	Pressure Network Diagram	Revision	Date	App'd	MWR No.
C	\$																			
X	\$																			
Gross	\$																			
M & R	\$																			
Plt. Ret.	\$																			
				Tel. Compl. Date		EL. Service Req'd Date				Municipality	T/O DOBBS FERRY									
				EL. Jt. No.						Issue Date										
										Job Class	FAMXJ									

**NOTE: REFER TO PLATT DOBBS FERRY FILE NO. 18 BLOCK 526 FOR POSSIBLE USE OF EXISTING CONDUIT**

**\* = EL METER**


**MATERIAL LIST**

QTY	DESCRIPTION	O.D.	FM
460'	3492MT-48		
1	MOPT-6 E/W 100' STUB		
1	MOPT-12 E/W 50' STUB		

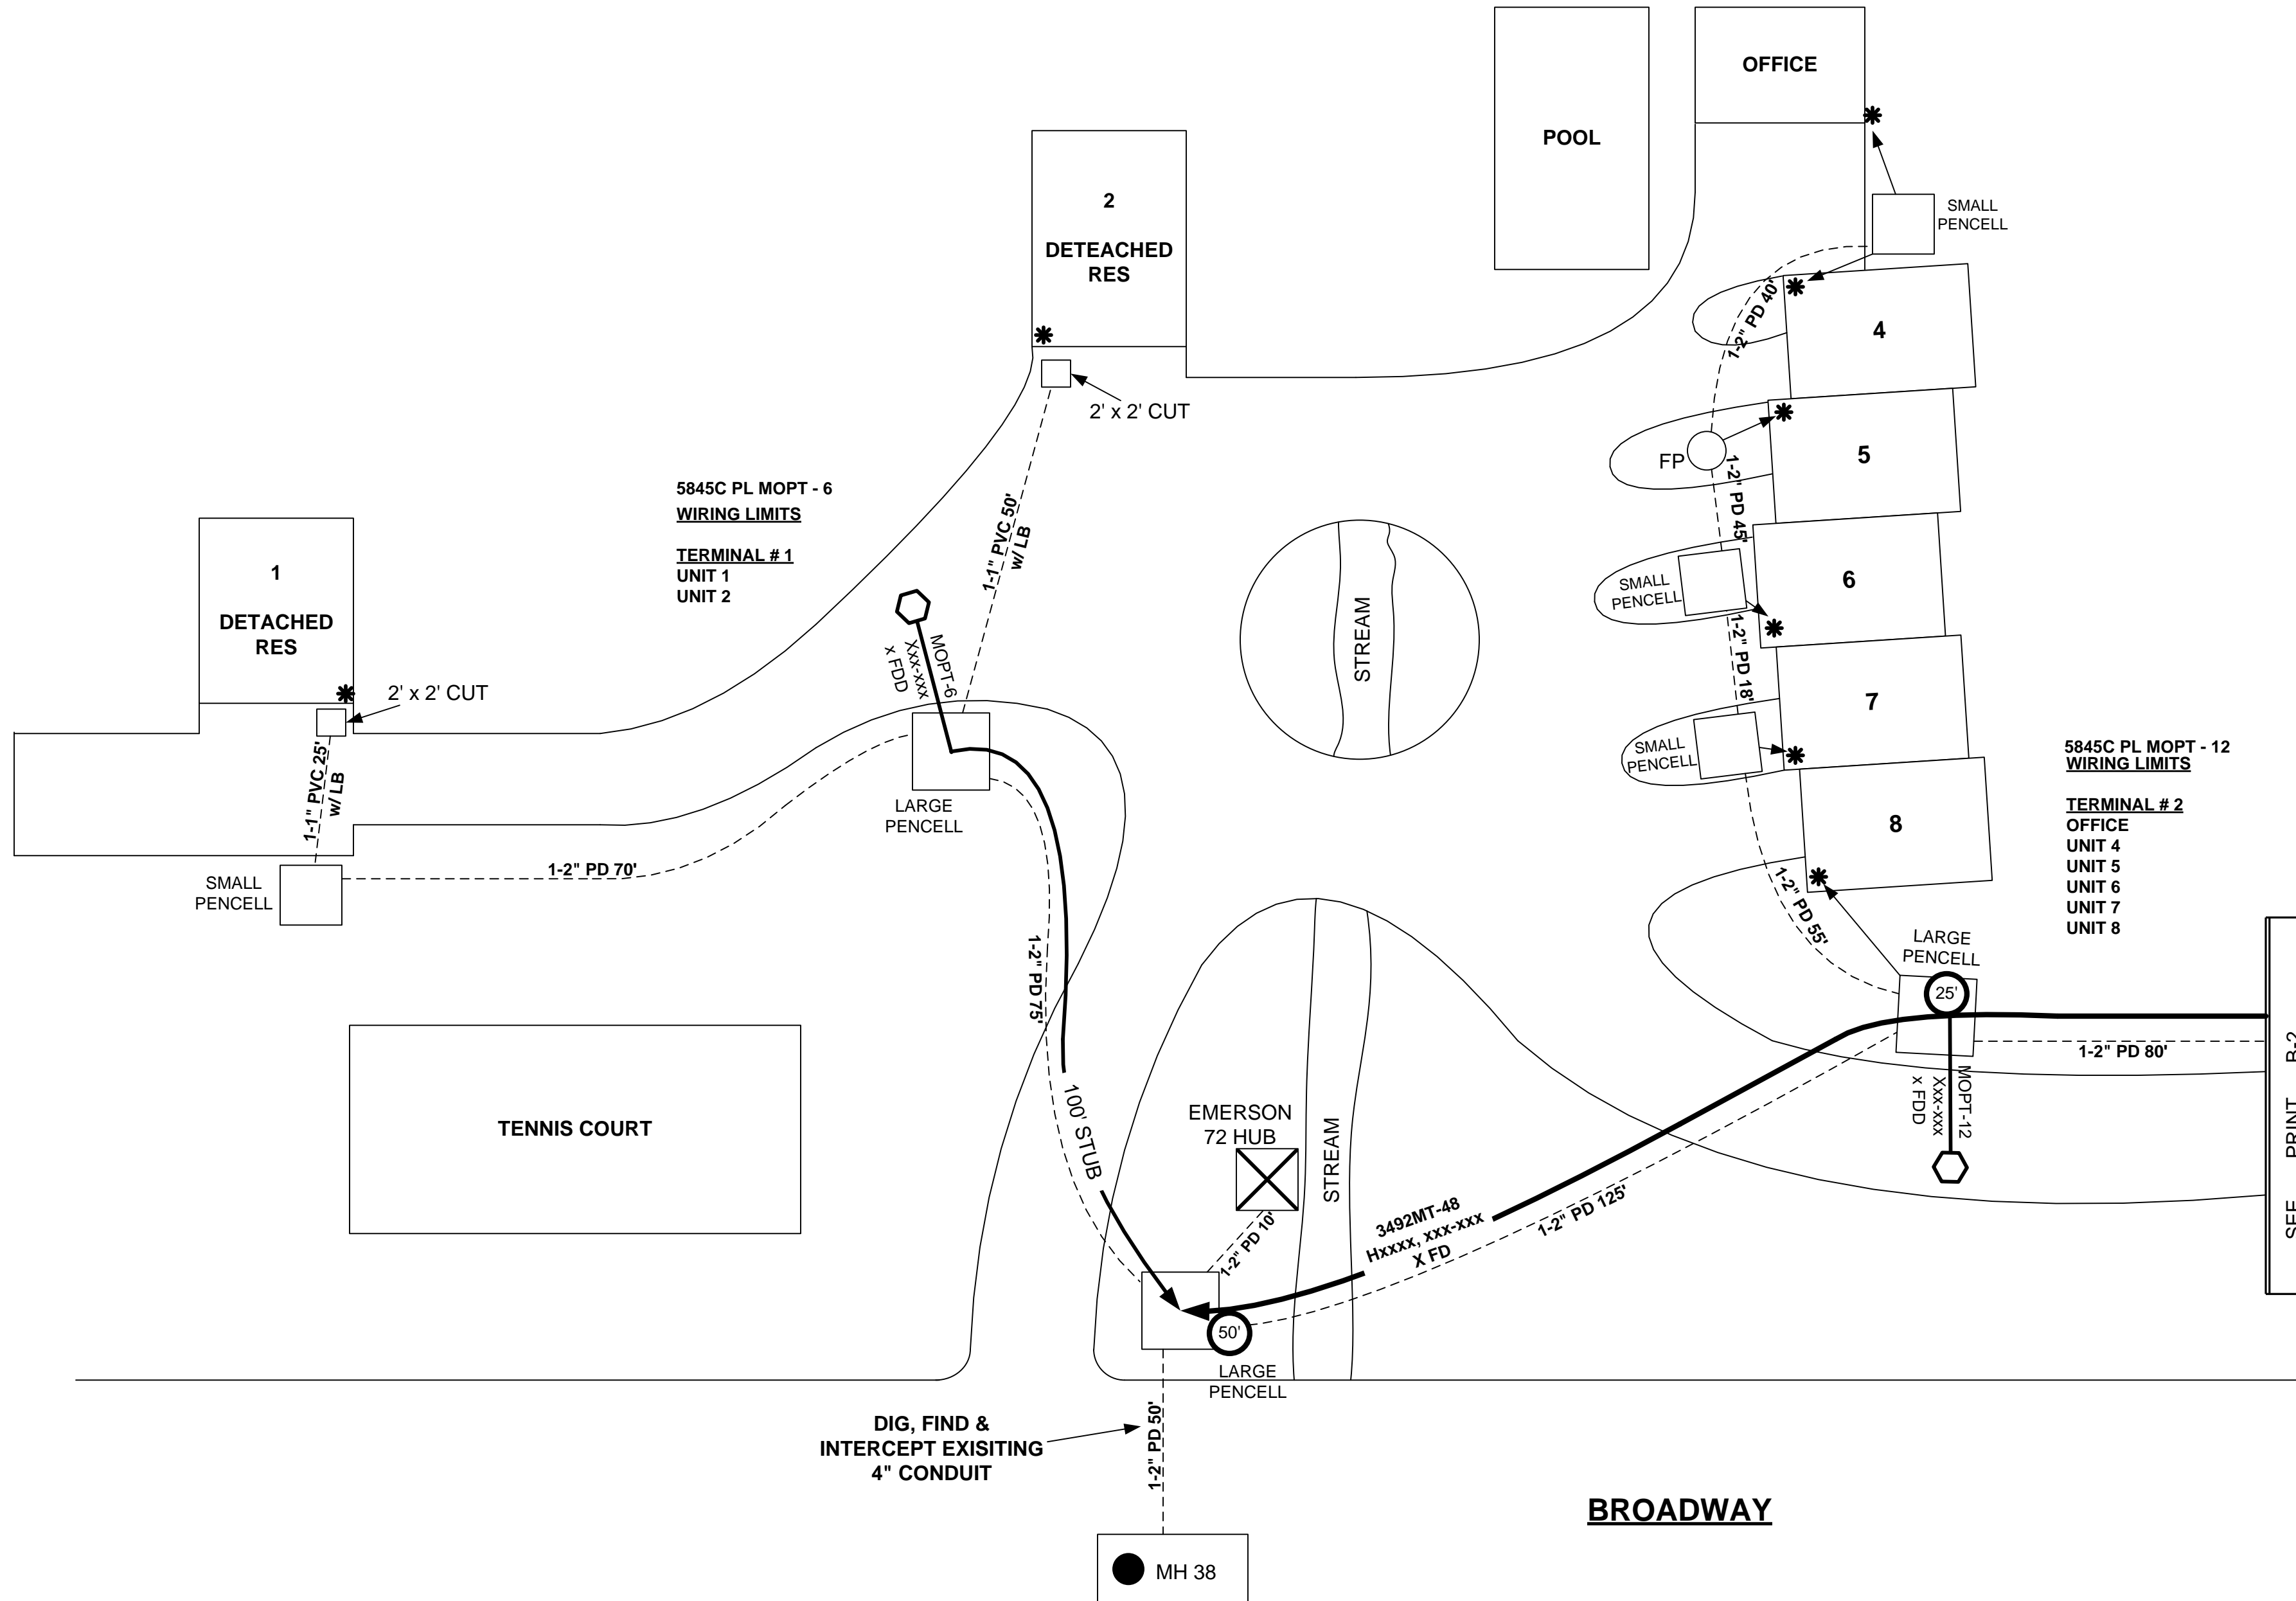

SEE PRINT B-2


**BROADWAY**

		<b>Record Reference</b> U.G. _____ Aer. _____ Block _____ Conduit _____		<b>R.O.W./Permits</b> <input type="checkbox"/> _____ <input checked="" type="checkbox"/> _____		<b>Job Planned By</b> Engr. _____ Tel. No. _____ Draftsman's Initials _____ Planner's Int. _____ Sub-Dist _____ Date _____		<b>Estimate</b> Keep Cost _____ C.W. Order _____ Rou. Order _____ Print No. C-2 C.O. DOBBS FERRY Division WCHR District _____ Date _____ Block No. _____ Division _____ Date _____ Tax Dist. _____											
<b>Reason For Work</b> <b>FTTP - DOBBS FERRY</b> <b>152 BROADWAY, DOBBS FERRY</b> <b>H3003</b>				<b>Est. Cost</b> <table border="1"> <tr><td>C</td><td>\$</td></tr> <tr><td>X</td><td>\$</td></tr> <tr><td>Gross</td><td>\$</td></tr> <tr><td>M &amp; R</td><td>\$</td></tr> <tr><td>Plt. Ret.</td><td>\$</td></tr> </table>		C	\$	X	\$	Gross	\$	M & R	\$	Plt. Ret.	\$	<b>Primary Voltage To Ground</b> 13.2KV <b>Pressure Network Diagram</b> _____ Tel. Compl. Date _____ EL. Service Req'd Date _____ EL. Jt. No. _____		Revision _____ Date _____ App'd _____ MWR No. _____ EL. Grid _____ Municipality T/O DOBBS FERRY Issue Date _____ Job Class FAMXJ	
C	\$																		
X	\$																		
Gross	\$																		
M & R	\$																		
Plt. Ret.	\$																		
<b>RULE 53</b> Tel. Underground Plant Involved <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/> Does Not Apply <input type="checkbox"/> Does Apply As Follows																			

**MATERIAL LIST**

QTY	DESCRIPTION	O.D.	FM
2	MOPT-6 E/W 100' STUB		
1	MOPT-6 E/W 50' STUB		

\* = EL METER

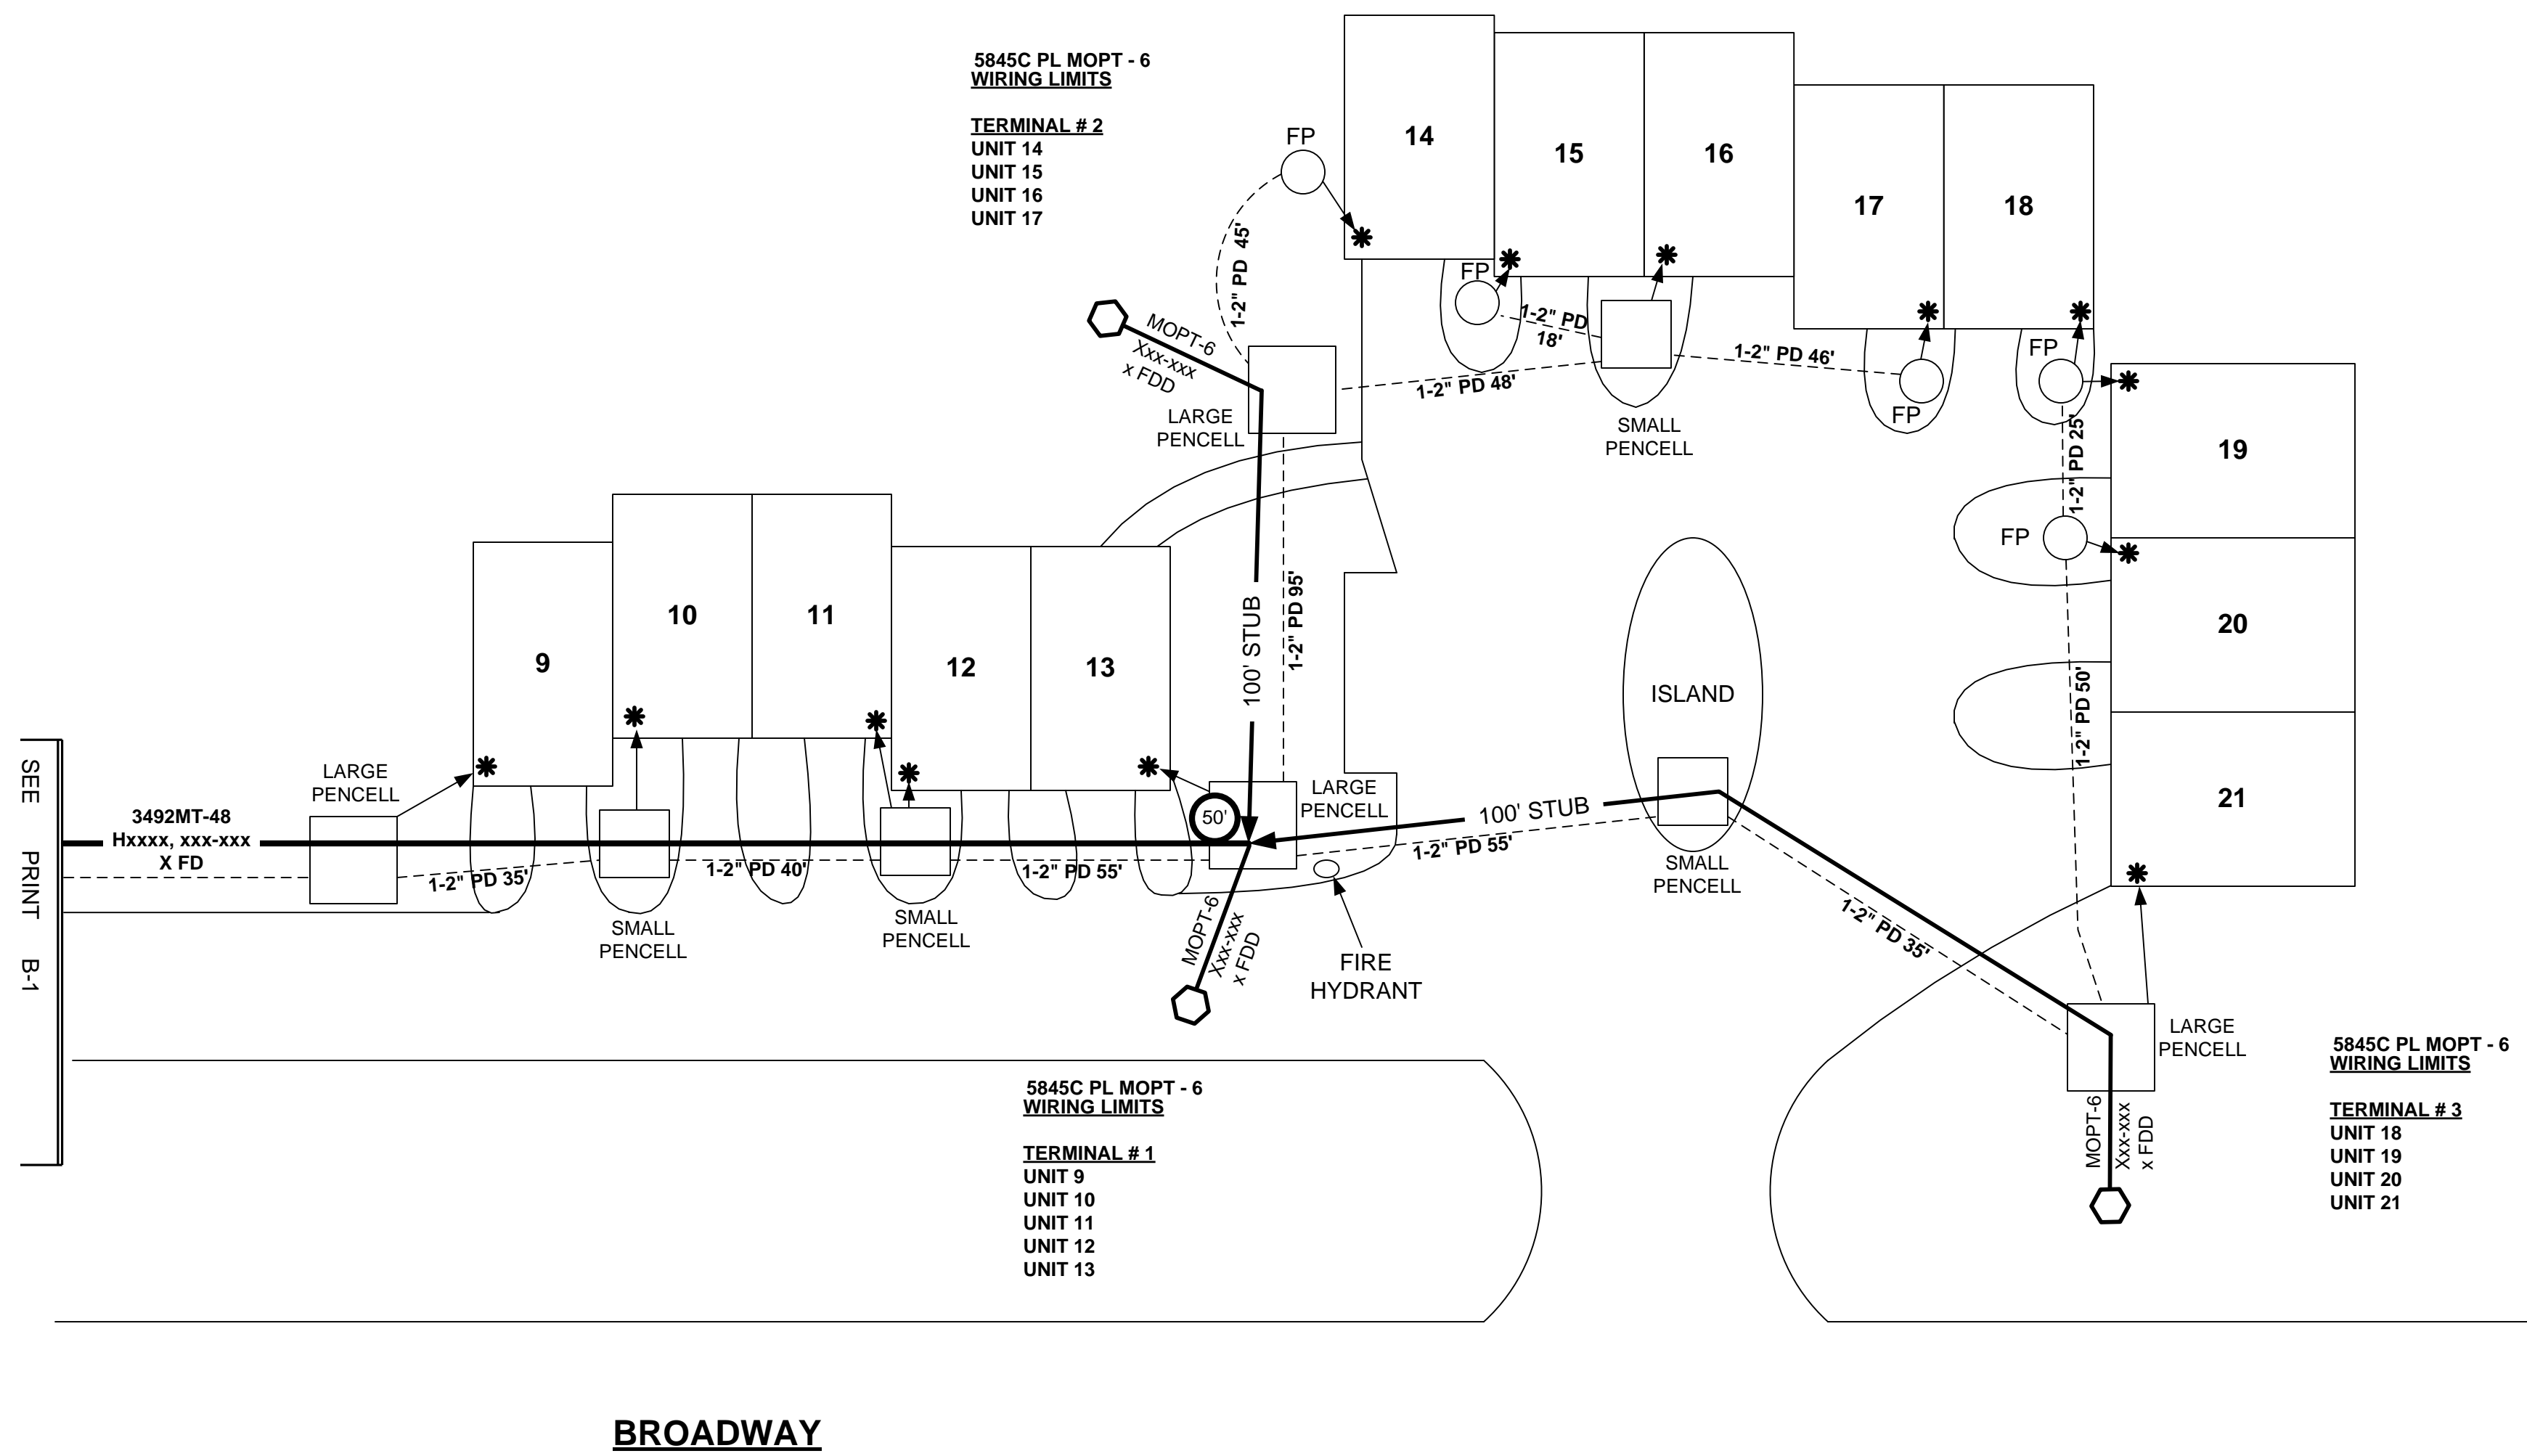

SEE PRINT B-1